

FIRE COMPANY CERTIFICATION:

NAME & TITLE

NATURAL RESOURCES CONSERVATION SERVICE CERTIFICATION:

NAME & TITLE

FREEZE PROTECTION

8" PVC FROM HEAD ASS'Y TO BELOW NORMAL WATER: ANNULAR SPACE FILLED WITH INSULATION FOAM. (PREMOLDED OR EXPANDING FOAM)

GUARD POSTS - SEE NOTE #1

YES ___ NO ___

YES ___ NO ___

BILL OF MATERIALS				
ITEM	MARK	QUAN.	UNIT	
4" HYDRANT ASSEMBLY - 45° ELBOW HYDRANT CAP	1	1	EACH	
4" 3' PVC STRAINER	2	1	EACH	
4" SCH. 40 PVC 45° ELBOW	3	1	EACH	
4" SCH. 40 PVC PIPE-RISER	4	1	EACH	
4" SCH. 40 PVC PIPE	5	---	LN. FT.	
4" SCH. 40 PVC COUPLINGS	6	---	LN. FT.	
UNDER-WATER SUPPORT	7	---	EACH	
PVC GLUE	8	1	CAN	
PRIMER CLEANER	9	---	CAN	
4" STRAINER CAP		1	EACH	

SITE DATA

ITEM

POOL

DROUGHT POOL

MINIMUM DRAW

MAXIMUM DRAW

AVAILABLE WATER AT NORMAL LEVEL

AVAILABLE WATER AT DROUGHT LEVEL

ACRES


ACRES

FEET

FEET

GAL.

GAL.

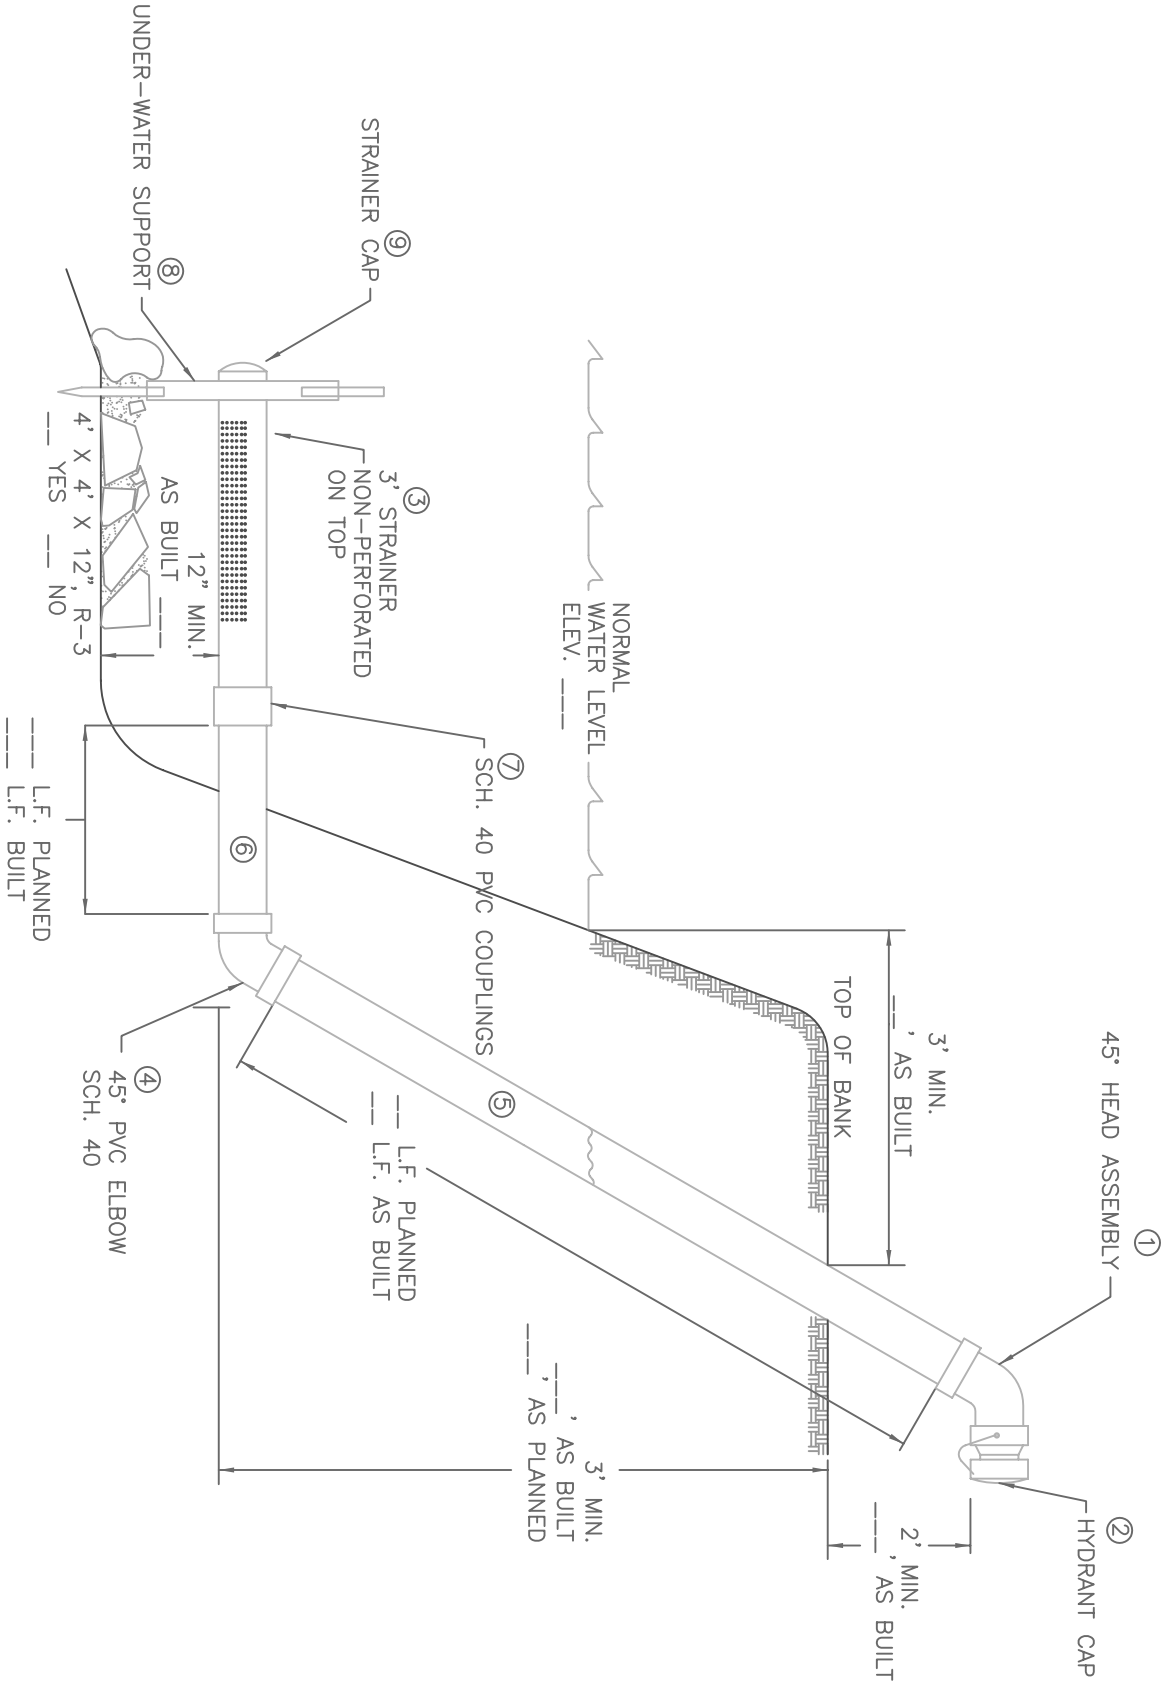

PROFILE

NOT TO SCALE

- NOTES:
1. FOR GUARD POSTS, IF REQUIRED, SHALL BE

2. UNDER-WATER SUPPORT CAN BE COMMERCIAL KIT OR CONSTRUCTED FOR LOCAL CONDITIONS.

_____ COUNTY, PENNSYLVANIA

4" DRY HYDRANT - SLOPING



File No.

PA-0584.dwg

Drawing No.

PA-0584

Sheets

_____ of _____